

EXCENTRIC COI
(IF APPLICABL

$$\underline{\dot{z}}$$

STRUCTUR

EXCENTRIC COM

EXCENTRIC COM

- GRAVEL BACKFILL 12" MIN.
ABOVE CROWN OF PIPE. NATIVE
BACKFILL COMPACTED TO 95%
DENSITY TO SUBGRADE.

COMPACTION REQUIREMENTS FOR STORM DRAIN AND SANITARY SEWER STRUCTURES

N.T.S.

NOTES:


1. STRUCTURES INCLUDE STORM DRAIN MANHOLES, CATCH BASINS, AND SANITARY SEWER MANHOLES.
2. REQUIREMENTS APPLY TO VALVE CANS AS SHOWN.
3. CLEARANCE SHALL BE LARGE ENOUGH TO USE A MECHANICAL COMPACTOR.
4. REFER TO CITY DETAIL R8 FOR UTILITY ADJUSTMENTS.
5. BACKFILL SHALL BE COMPACTED IN A MAXIMUM OF 6 INCH LIFTS.

2. REQUIREMENTS APPLY TO VALVE CANS AS SHOWN.

3. CLEARANCE SHALL BE LARGE ENOUGH TO USE A MECHANICAL COMPACTOR.

4. REFER TO CITY DETAIL R8 FOR UTILITY ADJUSTMENTS.

5. BACKFILL SHALL BE COMPACTED IN A MAXIMUM OF 6 INCH LIFTS.

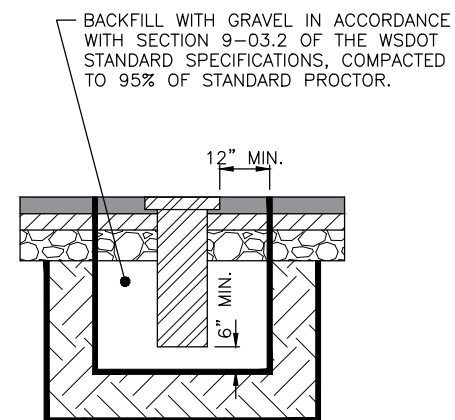

12" MIN.

MIN.

VALVE CAN DETAIL

N.T.S.

STANDARD DETAIL STRUCTURE COMPACTION REQUIREMENTS

STRUCTURE COMPACTION

REQUIREMENTS



SCALE: AS SHOWN		DATE DRAWN		REVISIONS	
DESIGNED	DRAWN	CHECKED	DATE	INITIAL	
JB	RLK	JB	10/26/2020	CAW	
APPROVED BY			01/01/2022	AJS	
		DATE APPROVED			
		STANDARD SPECIFICATIONS			

DETAIL NO.
R-300

PAGE
1 OF 1